

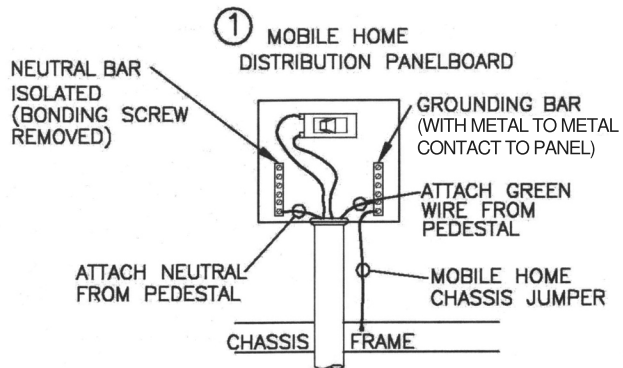


MANUFACTURED HOUSING WIRING GUIDE (UNDERGROUND)

* KENERGY'S ENGINEERING DEPARTMENT
WILL SPOT LOCATION TO SET
METER POLE

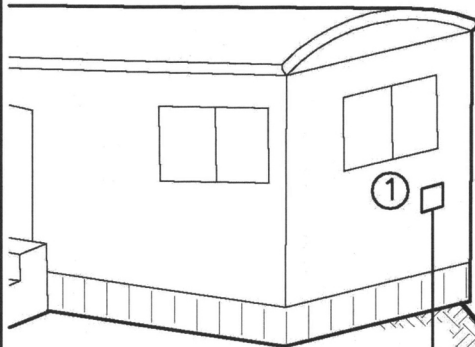


- ② CABLE BURIAL DEPTH
24" MINIMUM FROM TOP OF THE CABLE
UP TO THE FINAL GRADE (IF CABLE IS
IN RIGID NONMETALLIC RACEWAY,
18" DEPTH IS MINIMUM.

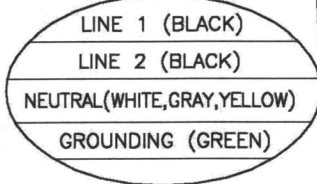

③ UTILITY APPROVED SERVICE PEDESTAL
SHALL BE READILY ACCESSIBLE,
WITHIN SIGHT OF AND NOT MORE
THAN 30' FROM THE EXTERIOR WALL OF THE
HOME IT SHALL ALSO CONTAIN A MEANS FOR
SERVICING ADDITIONAL ELECTRICAL LOAD
OUTSIDE THE HOME. ANY 120 VOLT
15-20 AMP RECEPTACLES SHALL BE GFCI
PROTECTED.

- ④ REQUIRED GROUND ROD:
8' GROUNDING ELECTRODE SHALL BE INSTALLED
(A SECOND GROUNDING ELECTRODE IS
REQUIRED IF RESISTANCE IS OVER 25 OHMS.)

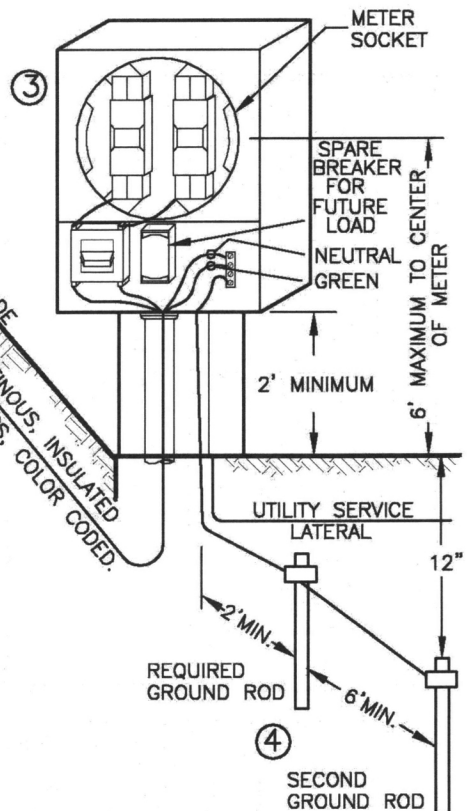

AMPS	FEEDER CIRCUIT PEDESTAL TO MOBILE HOME				INSULATED COPPER GROUNDING WIRE (GREEN)
	CONDUCTOR	RHW,UF,URD,OR EQUIV.	ALUM	CONDUIT	
100	#4	1¼"	#2	1¼"	#8
150	#1	1½"	#2/0	1½"	#6
200	#2/0	2"	#4/0	2"	#6

KENERGY CORP